

PROJECT

**Dirick Hill Wind Farm
 110kV Grid Connection**

CLIENT



CONSULTANTS

NOTES: -

1. Layout and Arrangements of Substation Building and Electrical Equipment is shown indicatively and for illustration purposes only.
2. Dimensions shown are as per current EirGrid Specifications at the time of submission. Dimensions may vary at time of construction to reflect any revisions to EirGrid Specifications.
3. Final Specifications of Buildings and Electrical Equipment is to be as per EirGrid and ESB Specifications.
4. The Elevation of the Compound is indicative and will be finalised to project design to ensure Cut/Fill Earthworks associated with the construction of the Compound are balanced.

LEGEND: -

	Description
CSE	Cable Sealing End.
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
PI	Post Insulator.
LM	Lightning Mast.

ISSUE/REVISION

NO.	DATE	DESCRIPTION

P0	16.09.22	Issued For Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER


05-829

SHEET TITLE

Proposed Station Elevations


SHEET NUMBER

05829-DR-180

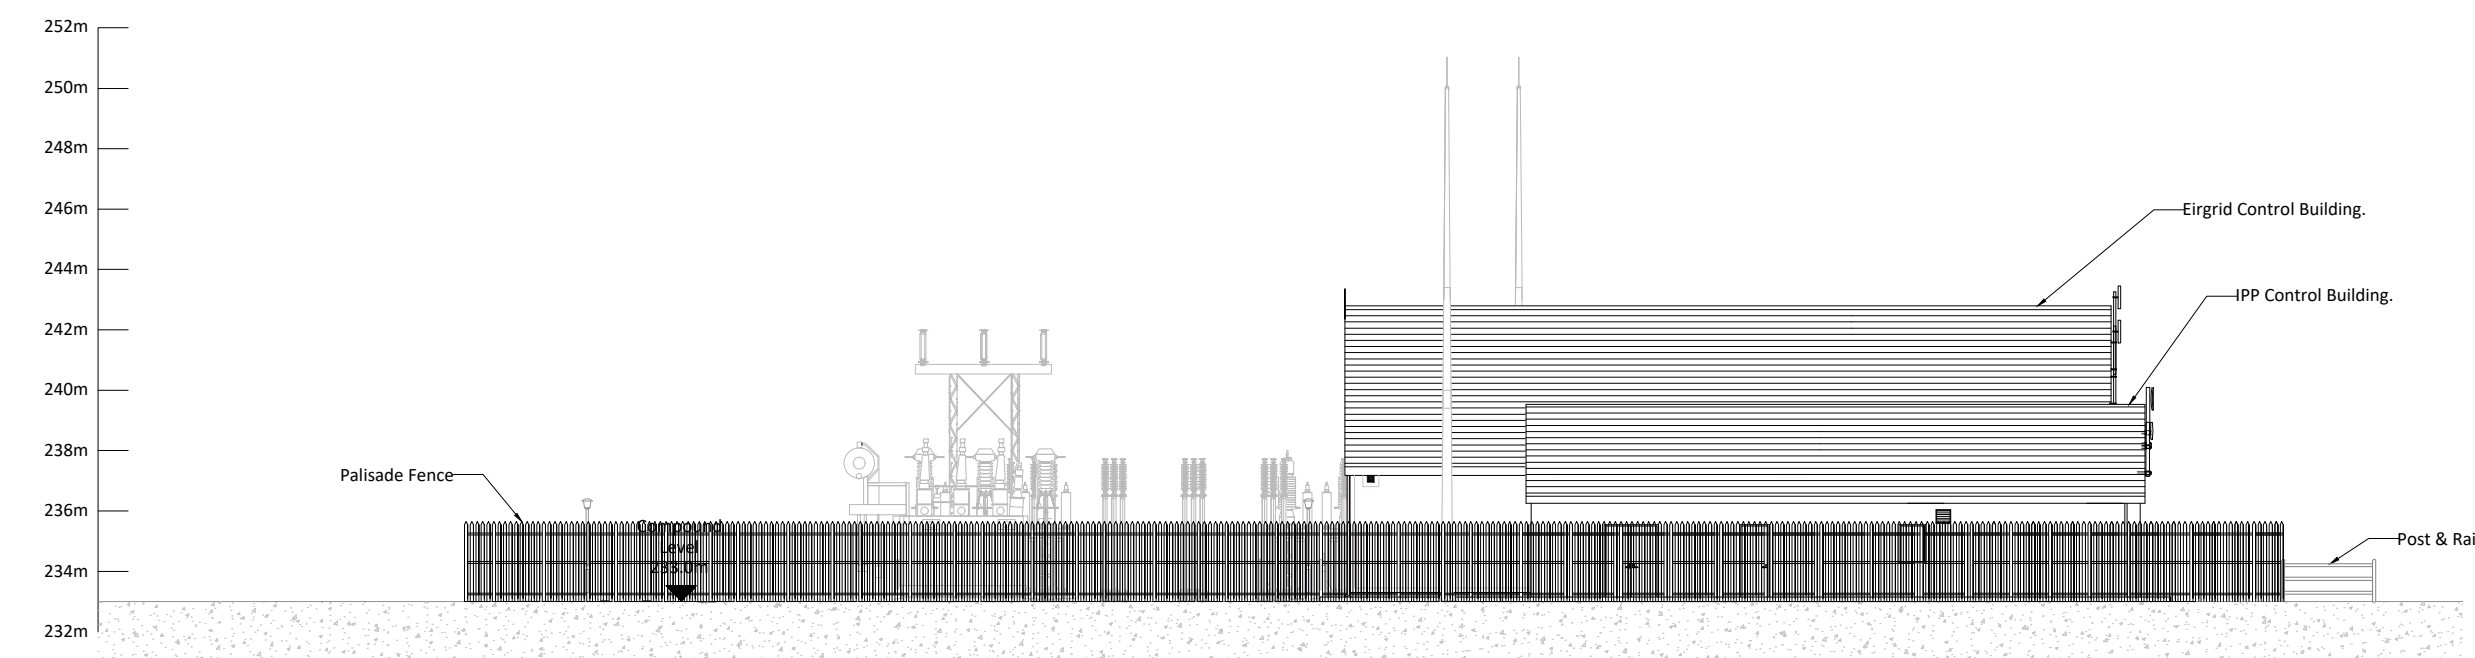


North East Elevation

SCALE 1:250

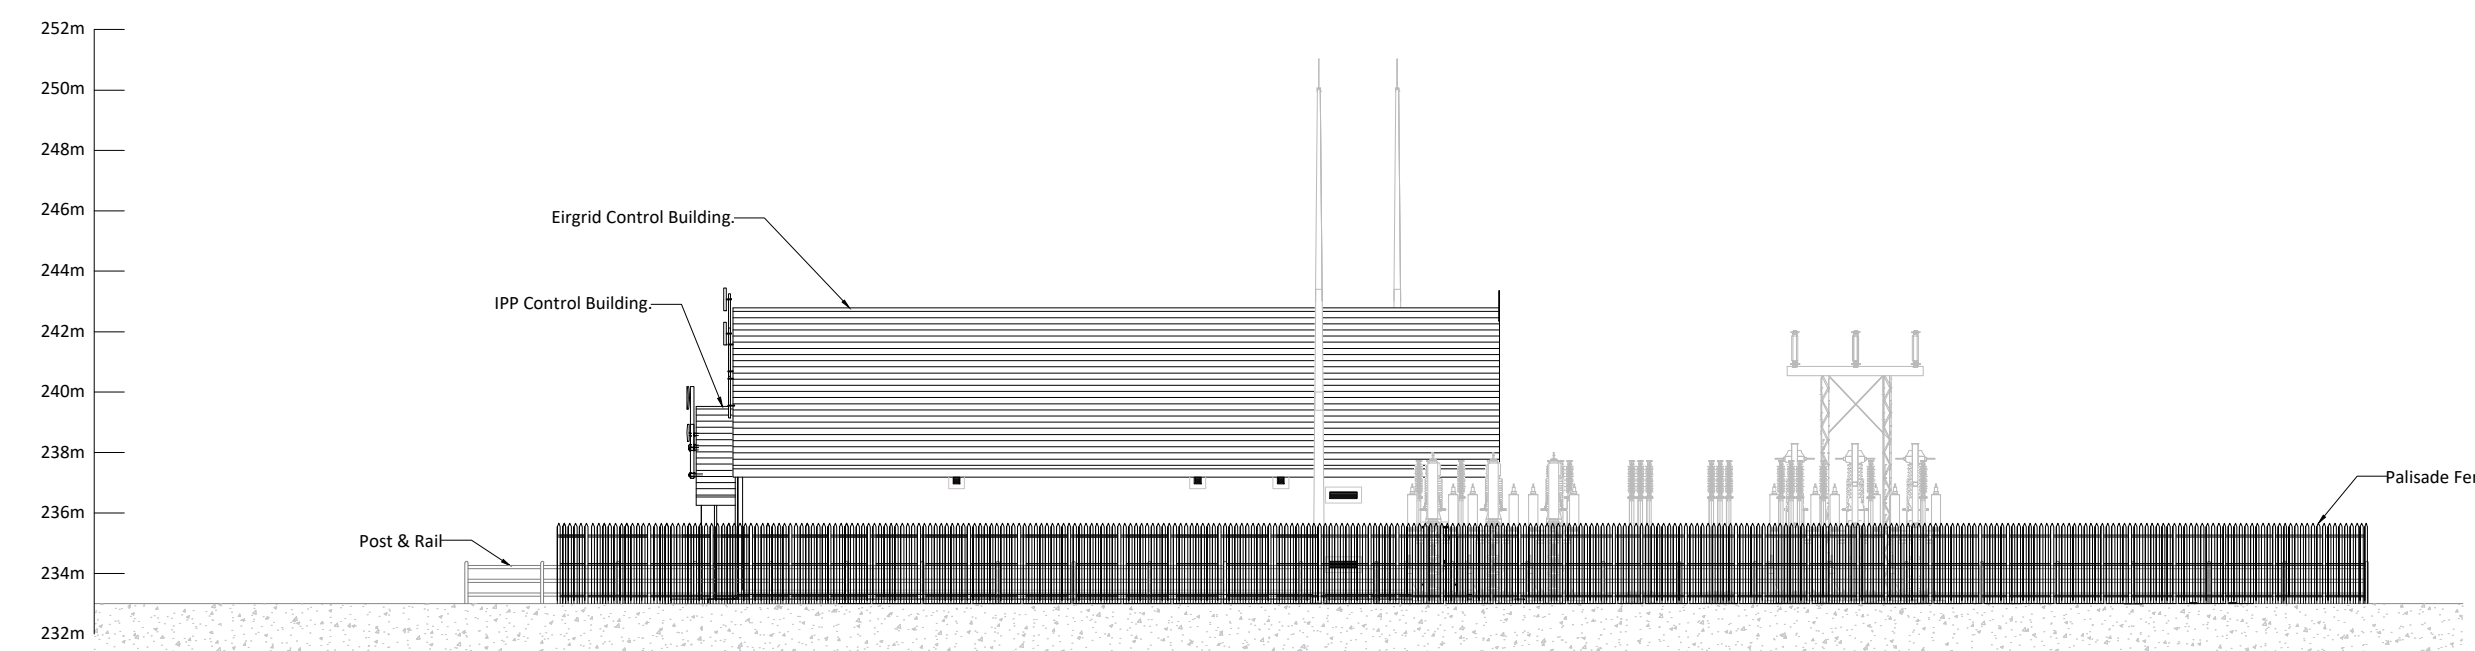


South West Elevation

SCALE 1:250

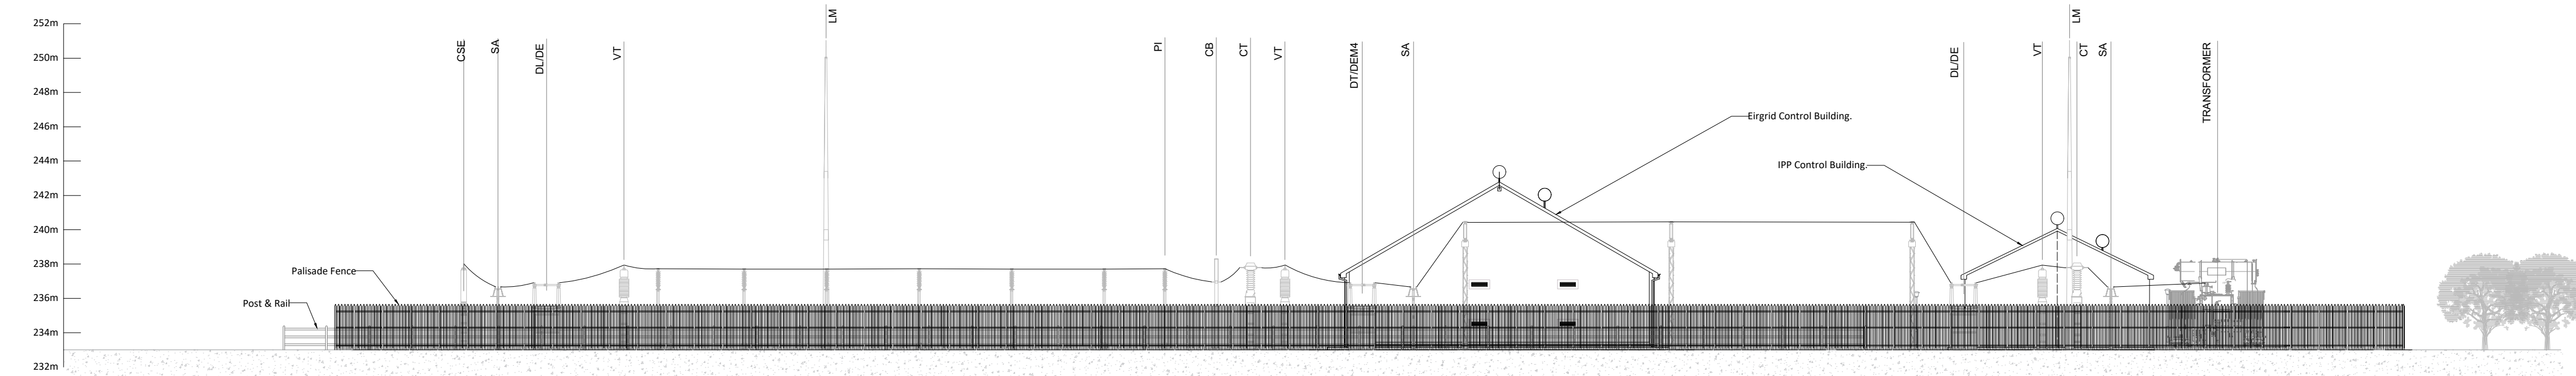

South East Elevation

SCALE 1:250

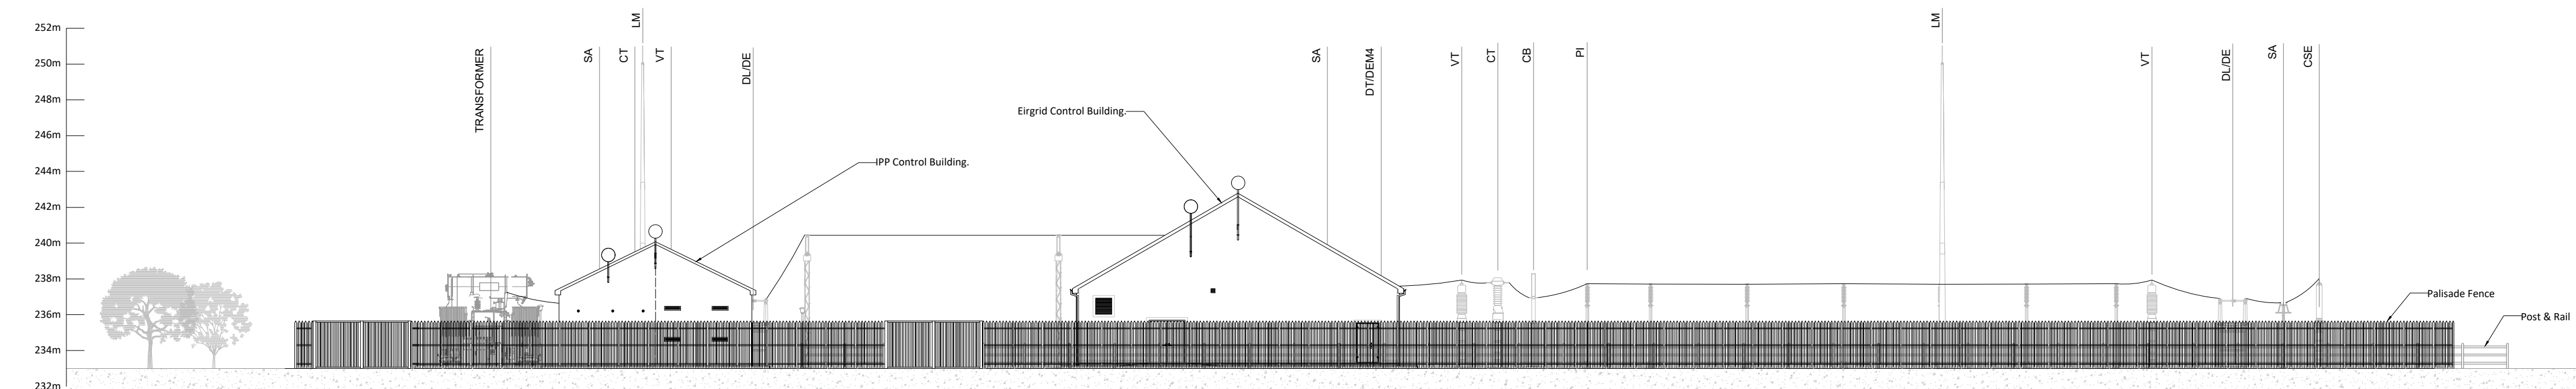

South West Elevation

SCALE 1:250