



ELEVATION OF FENCE
SCALE 1:50

SIDE ELEVATION OF POST
SCALE 1:50

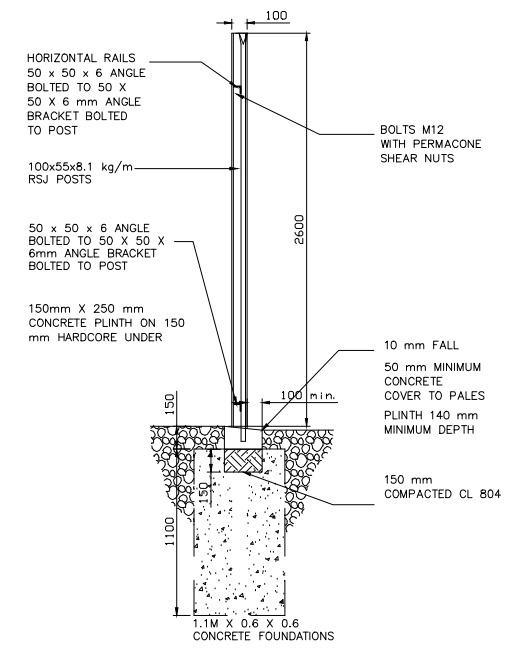

PALES & PLINTH DETAILS
SCALE 1:50

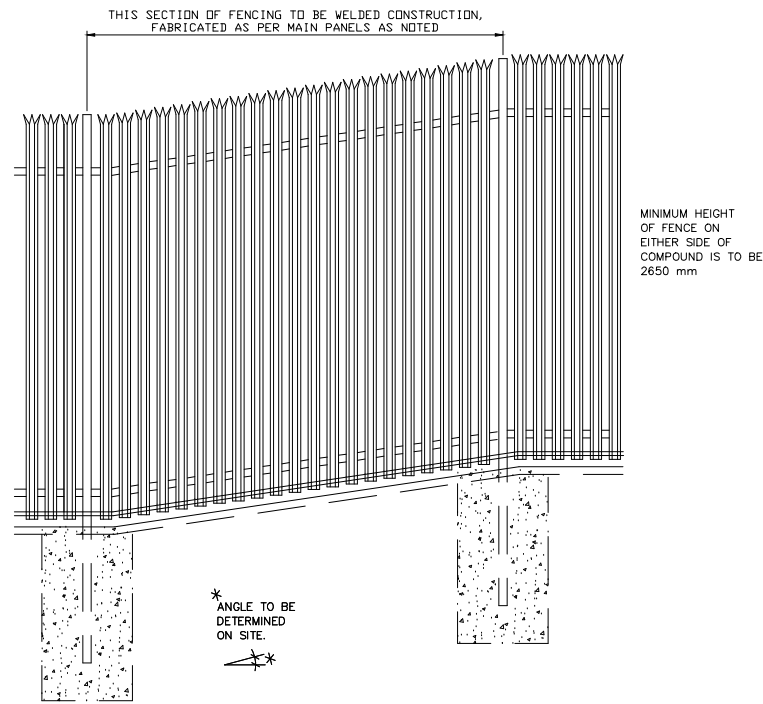

ELEVATION TO TYPICAL SLOPED SECTION OF FENCING
SCALE 1:50

- NOTES
1. THE FENCE IS TO BE CONSTRUCTED IN ACCORDANCE WITH B.S. 1722 PART 12
 2. GALVANISING TO BE IN ACCORDANCE WITH IS EN ISO 1461.
 3. POWDER COATING TO BE IN ACCORDANCE WITH IS EN 13438.
 4. PALES TO BE TRIPLE POINTED & SPLAYED, AND WELDED TO RAILS IN ACCORDANCE WITH CL. 5.1 OF BS 1722
 5. GAP BETWEEN PALES AND BETWEEN PALES AND RSJ TO BE NOT GREATER THAN 50MM.
 6. MINIMUM HEIGHT OF FENCE ON EITHER SIDE OF COMPOUND IS TO BE 2600MM
 7. CONCRETE TO BE GRADE C20/25 TO BASES, C30/37 TO PLINTHS

P01	Planning Application Submission	LB	05/23
P00	Issued for Comments	LB	03/23
rev.	modifications	by	date

Client
EMP Group

Project
Proposed Wind Farm and Grid Connection at Dyrick Hill, County Waterford.

Stage
Planning Application

Title
Pallisade Fence Details

Scales
1:50 @ A3

Surveyed	Prepared By	Checked	Date
	A.McC.	S.M.	01-11-2021

© COPYRIGHT OF
JENNINGS O'DONOVAN & PARTNERS LIMITED,
CONSULTING ENGINEERS,
FINISKLIN,
SLIGO,
IRELAND.

TEL. (0035371) 9161416.
FAX. (0035371) 9161080.
Email. info@jodireland.com
Web. www.jodireland.com

Job No.	Drawing no.	Revision
6497	PL-907	P01